


Module 4

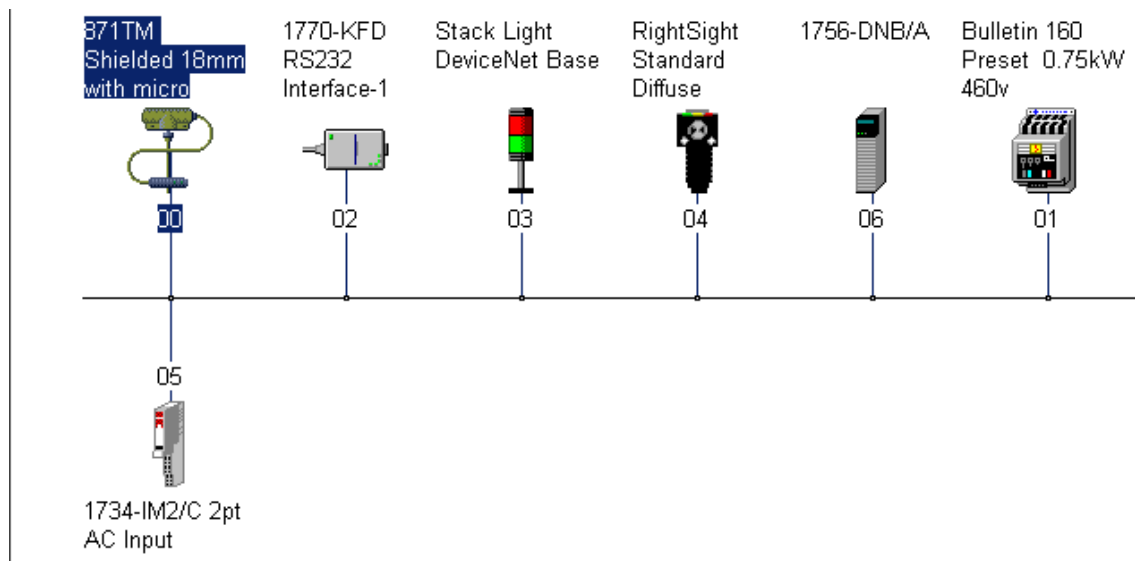

Lab Exercise 10

Downloading DeviceNet Configuration File

Downloading DeviceNet Configuration File

Lesson Objective

By the end of this session, students should be able to:

1. Download a DeviceNet Configuration File (*.dnt) to a DeviceNet Scanner .
2. Monitor Ladder Logic Project File controlling / monitoring DeviceNet network components.

	<u>Page</u>
Introduction	3
Deleting 1756-DNB Configuration	6
Downloading Configuration File to 1756-DNB Module.....	8
Review Questions	12

Introduction:

Lab Exercise 2 will cover downloading an RSNetWorx Configuration File to a 1756-DNB Scanner module.

Downloading an RSNetWorx Configuration File to a 1756-DNB Scanner module is similar to downloading a Project File to a ControlLogix processor.

In Lab Exercise 1 an RSNetWorx Configuration File named PLC220_Module4.dnt was saved with RSNetWorx for DeviceNet.

The same ControlLogix Project File created for Lab Exercise 1 will be used for this Lab Exercise - PLC220_Module_4_Dnet.L5K

Completion of Module 4 Lab Exercise 1 is required before working on Lab Exercise 2.

Many of the Steps detailed in Lab Exercise 1, such as going online to a DeviceNet network, clearing the Network Configuring from a 1756-DNB, etc. will be required.

Using Lab Exercise 1 as a reference will be beneficial.

Equipment Required:

Computer with RSLogix 5000 / Studio 5000 software
RSLinx software
RSNetWorx for DeviceNet software
Ethernet Port

ControlLogix Demo board with 1756-DNB module, 1756-processor
1756-Ethernet Communication Module
Discrete Input / Output Modules

DeviceNet Demo Board with 871TM Prox switch
RightSight Standard Diffuse Photoelectric Sensor
855T – Stack Light
1791D 8B8P Compact Block I/O
PowerFlex 4 VFD

Note: Other components are also installed on DeviceNet Demo Board

DeviceNet Configuration File required - PLC220_Module4.dnt

ControlLogix Project File - PLC220_Module_4_Dnet.L5K or the ACD version

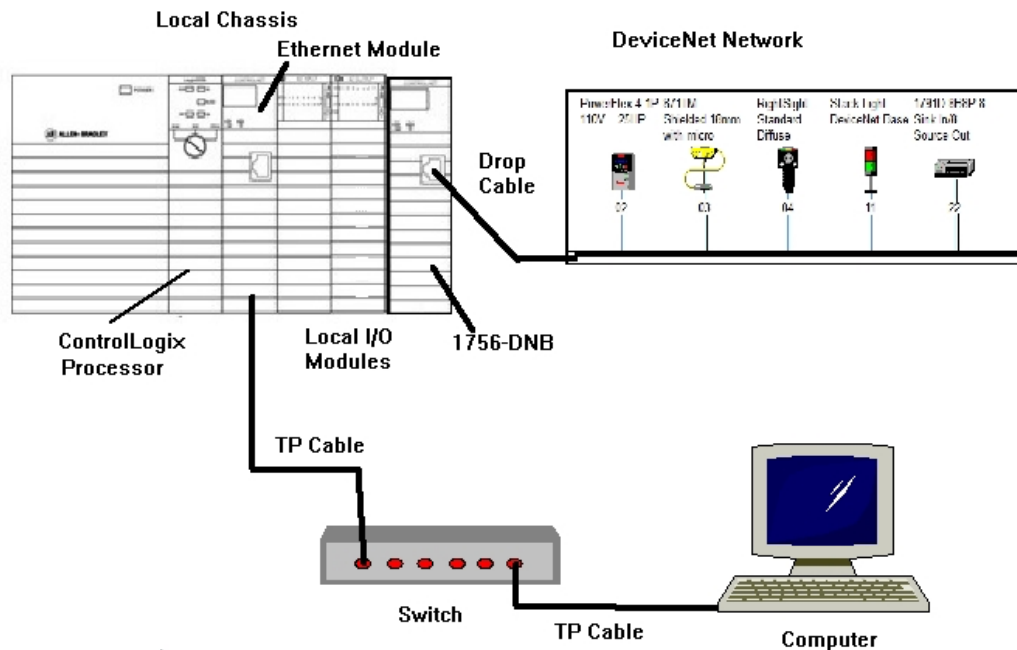


Figure 1-A

Ensure all the DeviceNet component's cables are connected to the IDC taps on the bottom of the DeviceNet Demo Board

Twisted pair Ethernet cables from Computer Ethernet Port to the 1756-EtherNet Module
Note: the cable may be directly connected - no Switch required

DeviceNet drop cable to connect the DeviceNet Demo Board to the front port on the 1756-DNB Module located on the ControlLogix Demo Board.

Power-up ControlLogix and DeviceNet Demo Boards

Note: If the display on the 1756-DNB Module shows - No Network Power – the 1756-DNB Module is not receiving power from the DeviceNet network (drop cable) cable.

In the Lab exercise a connection will be made from the computer's Ethernet Port to RSNNetWorx for DeviceNet using RSLinx EtherNet/IP Driver to connect to the DeviceNet network

Ensure the Computer can connect to the ControlLogix Demo board using the 1756 – Ethernet Communication Module with an EtherNet/IP driver.

Note: DeviceNet Scanner Module - 1756-DNB – located in slot 6.

Studio 5000

1. Import the PLC220_Module_4_Dnet.L5K file into Studio 5000
2. Download PLC220_Module_4_Dnet.ACD to the ControlLogix Demo
3. Place the ControlLogix processor into PROGRAM Mode.

RSNetWorx

1. Open RSNetWorx for DeviceNet.

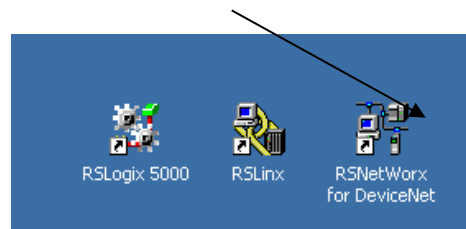


Figure 1-A. Execute RSNetWorx for DeviceNet.

2. Start a new DeviceNet Configuration File.



Figure 2-A
Window for New DeviceNet Configuration File

3. Go online to DeviceNet Demo Board.

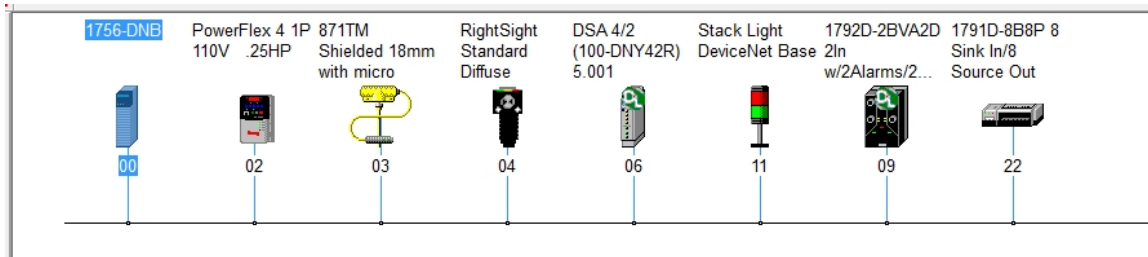


Figure 3-A
Online DeviceNet Demo Board

4. Clear the Scanlist from the 1756-DNB Scanner Module.
 - Navigate to 1756-DNB Properties -> Scanlist tab.
 - Click the << button to remove components for the Scanlist box

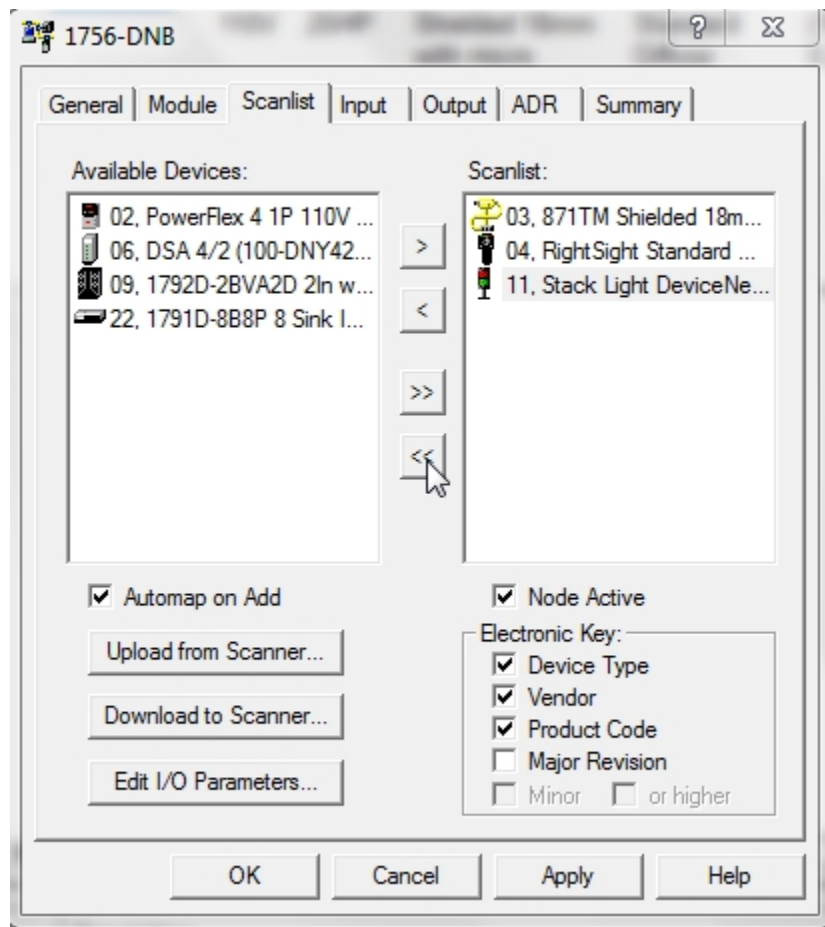


Figure 4-A
Clear Scanlist Box

The Scanlist tab window will appear as shown in Figure 5-A

Click the Apply button on the Scanlist tab window to download changes.

See Figure 5-A

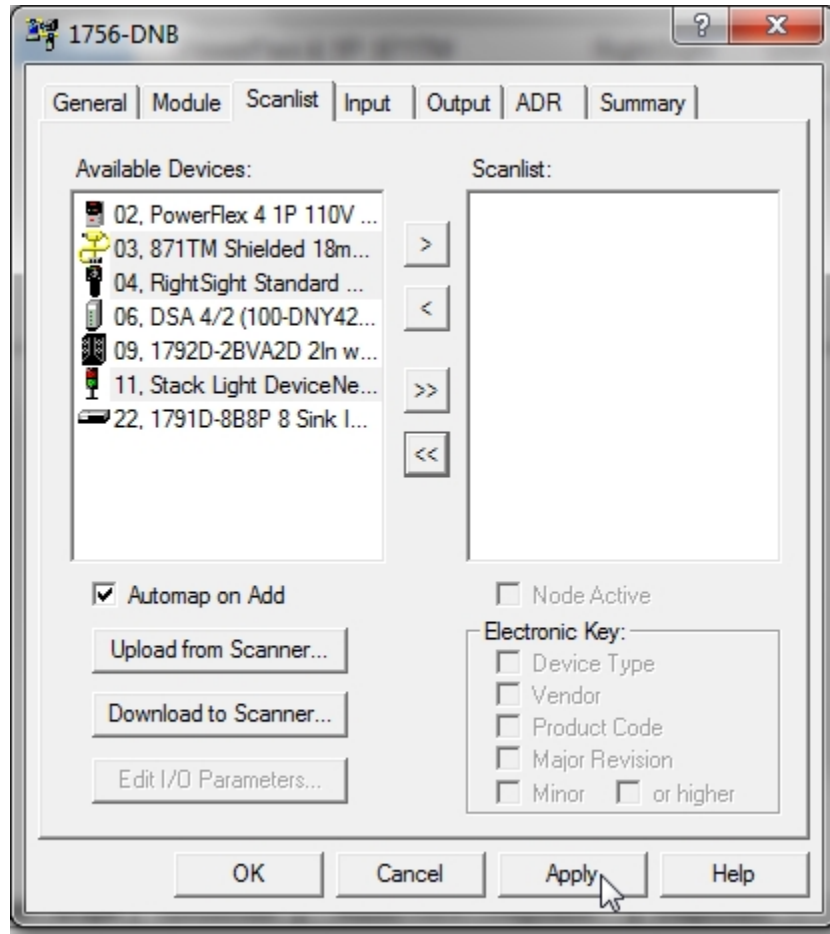


Figure 5-A
Cleared Scanlist Box

5. Click Yes button to confirm download changes to the 1756-DNB Module.

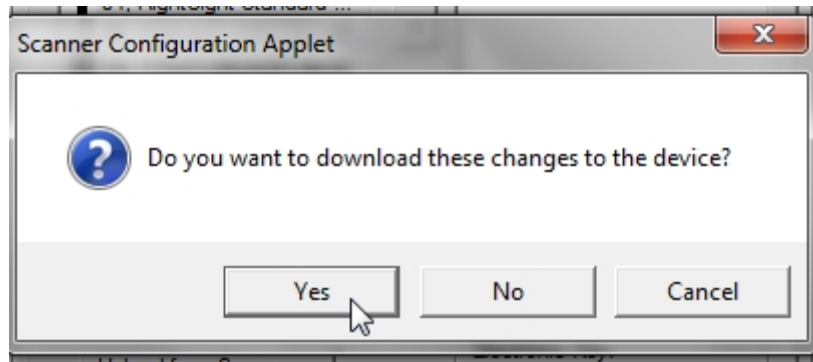


Figure 6-A.

6. Place the ControlLogix processor in RUN Mode
 - Verify Photoeye does not turn ON PL7
 - Verify SS4 Switch does not turn ON Stack Light Module 2
 - Verify 1756-DNB does not go into RUN Mode

Note: 1756-DNB will show NoRX and A#00

A#00 – 1756-DNB Node (MAC) Address

NoRX – no receive signals from any network devices

7. Place the ControlLogix processor in PROGRAM mode

8. Navigate to RSNetWorx for DeviceNet software

Open the PLC220_Module4.dnt DeviceNet Configuration File

- Click File -> Open from the Menu Toolbar

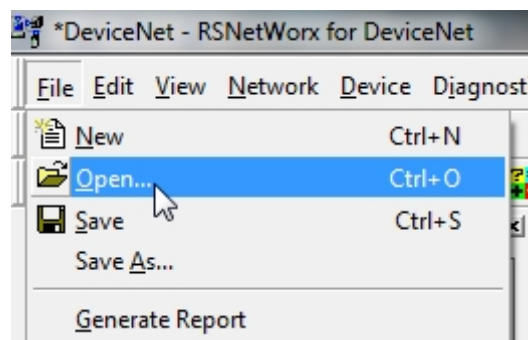


Figure 7-A. Open a configuration.

- Select PLC220_Module4.dnt Configuration file

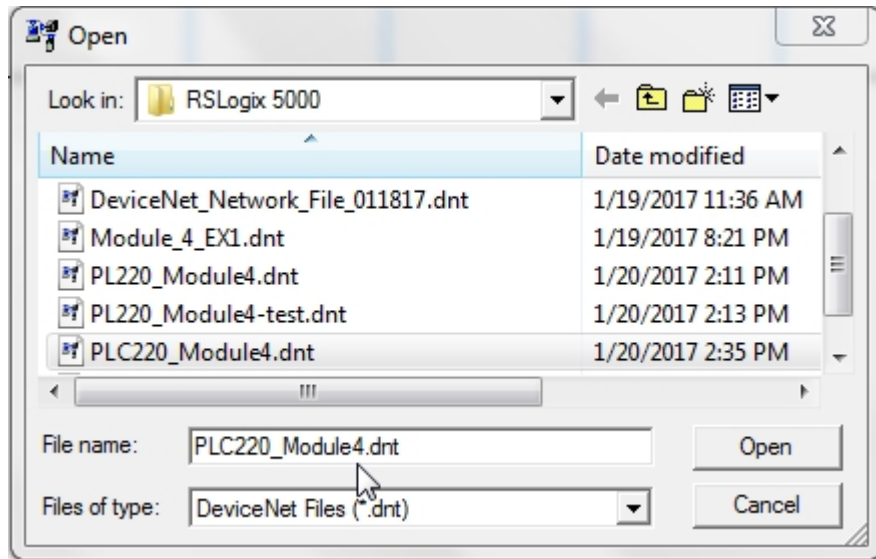


Figure 8-A. Choose the devicenet configuration to open.

Do not save any changes.

Click No button on the RSNetWorx window

See Figure 9-A

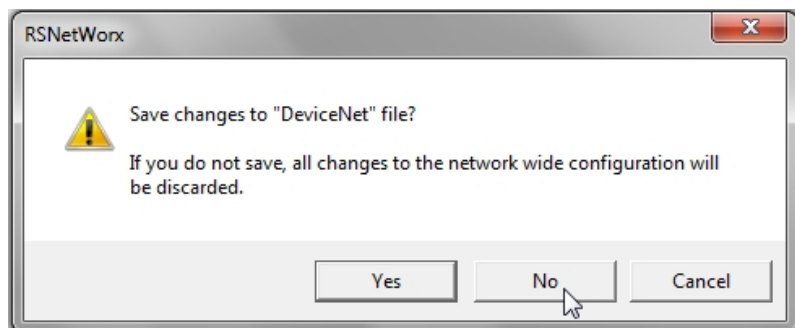


Figure 9-A. Do not save the changes.

9. The RSNetWorx Configuration Files opens offline

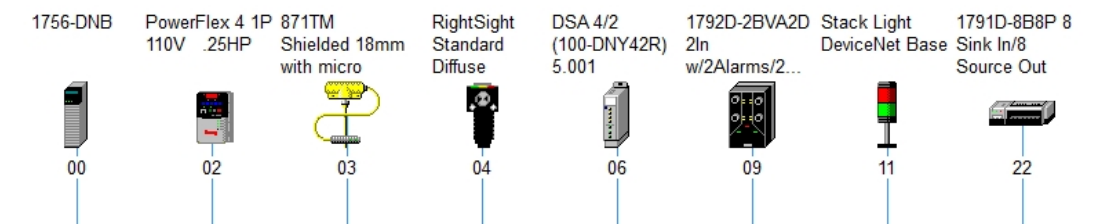


Figure 10-A
Offline Network Configuration File

RSNetWorx is Offline – View Mode in lower right corner of the RSNetWorx application



Figure 10-A
RSNetWorx Offline

10. Go Online

- Click Network on the Menu Toolbar
- Click Online

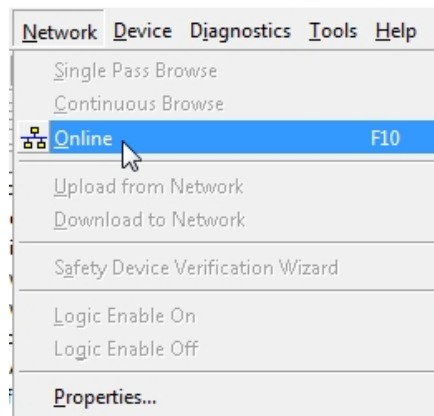


Figure 11-A
Go Online to DeviceNet Network

11. Click OK button on the RSNetWorx for DeviceNet window

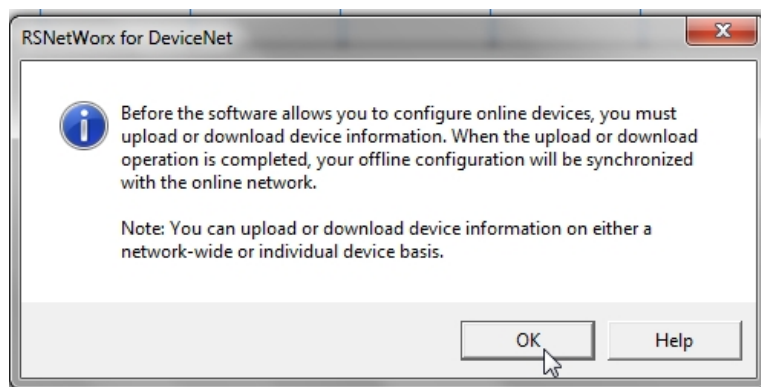


Figure 12-A

12. RSNetWorx browses the connect network

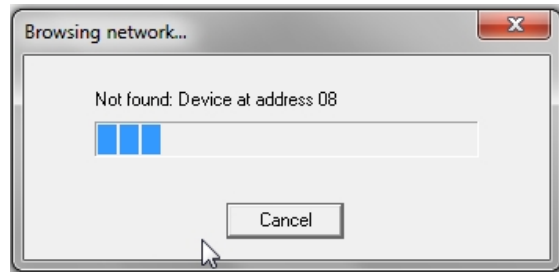


Figure 13-A
Browsing Online Network

13. When Browsing network window closes (Network Browse Completed) – Right click on the 1756-DNB Scanner module icon – Choose Download to Device

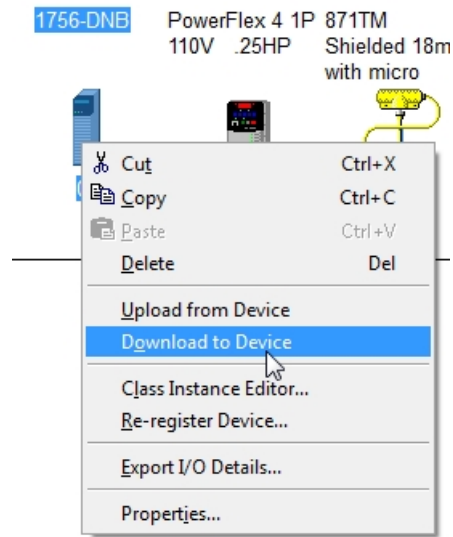


Figure 14 – A

14. Click Yes on RSNetWorx for DeviceNet window to confirm download

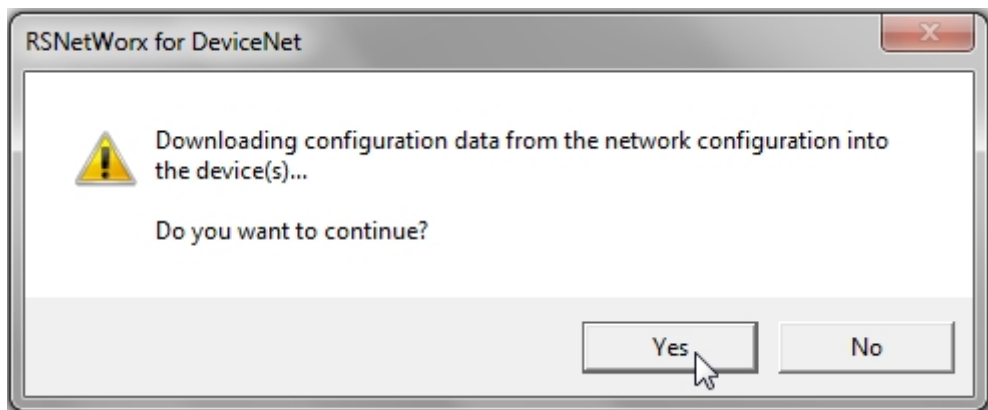


Figure 15 – A. Confirming the download.

Confirm Download

15. Downloading to Device(s) window monitors status of download.

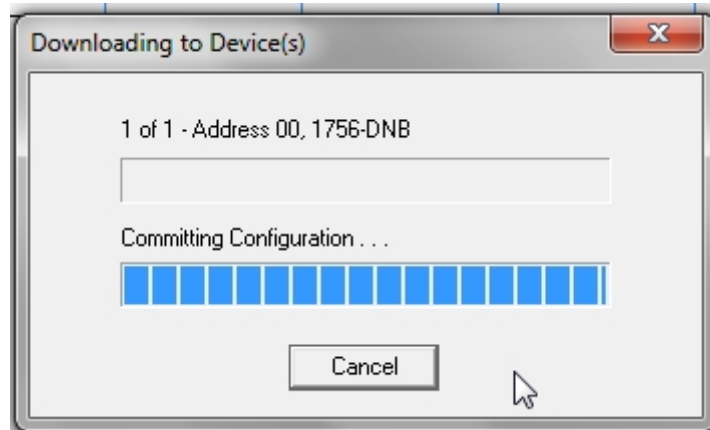


Figure 16 – A
Download Progress Bar

16. Place the ControlLogix processor in RUN Mode

Verify Operation

- Does SS7 Switch change 1756-DNB from IDLE to RUN Mode? _____
- Does Photoeye turn ON PL7? _____
- Does Prox Switch turn ON Module 1 of Stack Light? _____
- Does SS4 Switch turn ON Module 2 of Stack Light? _____

Review Questions

1. T F The 1756-DNB module has 124 Input Elements.
2. Which software is used to download DeviceNet Configuration Files to a DeviceNet Scanner Module:

- a) RSLogix 5000
 - b) Studio 5000
 - c) RSLinx
 - d) RSNetWorx
3. A# 00 is shown on the DNB display. This represents:
- a) Error Codes
 - b) Node Address.
 - c) Module mode
 - d) Baud Rate
4. T F RSLinx can be used to view DeviceNet nodes.
5. The software application that allows the ControlLogix processor to control / monitor devices on DeviceNet is stored in :
- a) Studio 5000
 - b) 1756-DNB
 - c) RSLogix 5000 software
 - d) RSLinx software
 - e) RSNetWorx software
6. T F DeviceNet configurations can be accessed through RSLinx software.

Review Question Answers

1) T

- 2) d
- 3) b
- 4) T
- 5) a, c
- 6) F

DOL DISCLAIMER:

This product was funded by a grant awarded by the U.S. Department of Labor's Employment and Training Administration. The product was created by the grantee and does not necessarily reflect the official position of the U.S. Department of Labor. The

Department of Labor makes no guarantees, warranties, or assurances of any kind, express or implied, with respect to such information, including any information on linked sites and including, but not limited to, accuracy of the information or its completeness, timeliness, usefulness, adequacy, continued availability, or ownership.



This work is licensed under a [Creative Commons Attribution 4.0 International License](https://creativecommons.org/licenses/by/4.0/).